



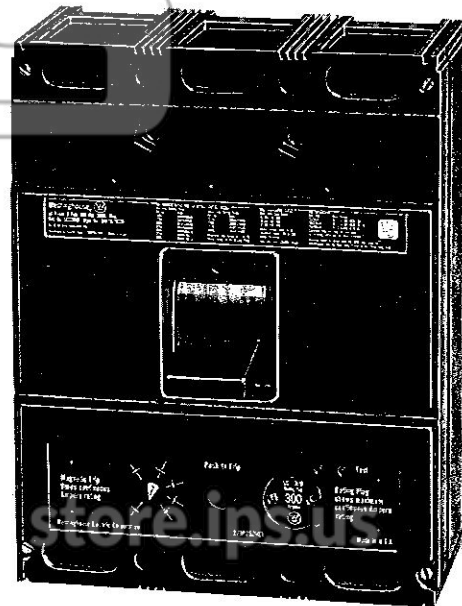

May, 1978  
 New Information  
 Mailed to: E, D, C/2770

Type LC and MARK 75® Type HLC  
 SELTRONIC™ Circuit Breakers, 150, 300, 600  
 Amperes

## AB DE-ION® Circuit Breakers

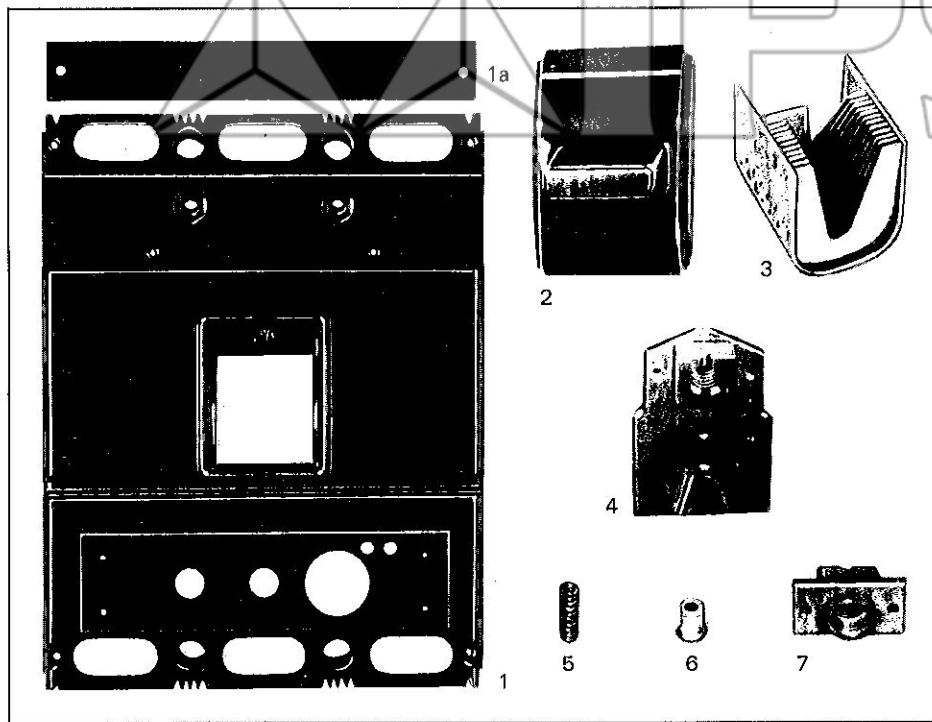

Reference Number	Description of Part	Style Numbers		Number Used
		150, 300 Amperes	600 Amperes	
Complete Breaker, Frame, Rating Plug or Accessories - See Technical Data 29-120				
1	Cover, Standard (Black) . . . . .	2607D76G01	2607D76H06	1
	Two or Three Poles			
	Cover, MARK 75 (Grey) . . . . .	2607D76G02	2607D76H07	1
1a	Cover, Line Terminal . . . . .		1262C53H03	1
	Standard or MARK 75			
2	Handle . . . . .	1310 986	1310 986	1
3	Arc Extinguisher . . . . .	451D727G04	506C002G01	1 per Pole
Ⓞ	Arc Extinguisher Barrier . . . . .	452D836H22	277A064H01, plus 277A065H03	1 per Pole
4	Stationary Contact Assembly . . . . .	455D568G07	505C976G02	1 per Pole
Ⓞ	Arc Runner . . . . .	455D566H03		1 per Pole
5	Moving Contact Spring . . . . .	1720 807	1720 807	1 per Pole
6	Moving Contact Spring Holder . . . . .	1301 064	1301 064	1 per Pole
7	Load Terminal Insert . . . . .	455D566G08	505C976G06	1 per Pole
Ⓞ	Barrier (End Plate) . . . . .	452D836H19	626B881H01	2 per Pole
Ⓞ	Terminals . . . . .	See Technical Data 29-120		

Ⓞ Not illustrated.

Ⓞ For older design breakers with large magnetic adjustment knob (approximately same diameter as rating plug), refer to Westinghouse with description of breaker and complete nameplate data.

*Underwriters' Laboratories, Inc. seal is voided and must be broken when any part of the breaker, except the interchangeable rating plug or certain field mountable accessories are replaced in the field.*

### Ordering Information

- Name part and give style number.
- Give complete nameplate rating.
- State method of shipment desired.
- Send all orders and correspondence to nearest Westinghouse sales office.



[store.ips.us](http://store.ips.us)

Printed in USA

---

Westinghouse Electric Corporation  
Distribution and Protection Business Unit  
Commercial Division - Components  
Beaver, Pennsylvania 15009